


JOB #:

ITEM #:

QUANTITY:

MOUNTING	HANDING	TYPE	SIZE	OTHER
----------	---------	------	------	-------

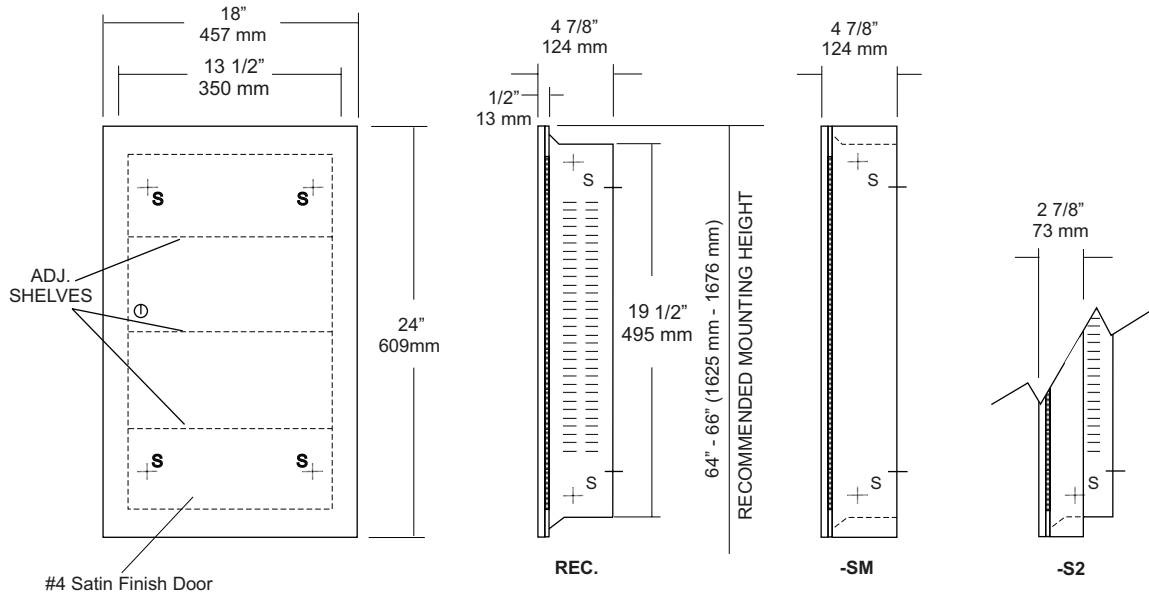

### SPECIFICATIONS

**Cabinet Body:** Fabricated of #22 ga stainless steel formed for rigidity. Embossed louvers in body allow shelving to be adjustable. Flange surrounds cabinet body that has 1/4" returns to wall. (No miters or welds)

**Cabinet Back:** Stainless steel secured to cabinet body with multiple welds to cabinet body.

**Uni-Door:** Fabricated of #18 gauge stainless steel with satin finish.

**Frame:** #22 ga stainless steel #4 satin finish.

**Adjustable Shelving:** Three (3) #22 ga stainless steel with #4 satin

**Lock:** Pin tumbler type.

**Hinges:** Full length, heavy duty stainless steel piano type

**Collars:** #22 ga stainless steel with #4 satin, one piece construction, finished to match cabinet body.

**Overall Size:** 18"W x 24"H x 4 7/8"D  
**457mm x 609mm x 124mm**

**Wall Opening:** 14"W x 20"H x 4"D  
**355mm x 508mm x 102mm**

**U7204-1824-S2:** semi-recessed Medicine Cabinet

**Wall Opening:** 2" wall opening required.

**U7204-1824-SM:** Full surface mounted cabinet.

### INSTALLATION

Secure cabinet with proper fasteners per application. After cabinet checks good, install adjustable shelving. Unit can be mounted to have a right hand or left hand swing door. Collars can be added in the field to accommodate semi-recessing or full surface mounting.

To comply with ADA code, one usable shelf must be mounted no higher than 44" above finished floor. (4.2.4)

### NOTES